



IF AGAINST BUILDING, INSTALL 1/2" PREFORMED NON-EXTRUDING EXPANSION JOINT TO BE SET 1/4" BELOW SURFACE OF WALK AGAINST BUILDING.
SEE ROADWAY CROSS SECTION FOR GRADING BEYOND SIDEWALK

5" THICK X 18" DEEP GRANITE CURB

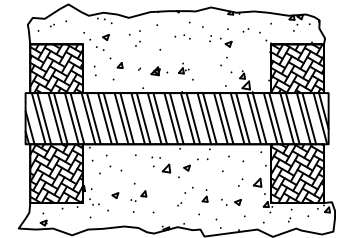

CURB INSTALLATION
TOP VIEW (TYP.)

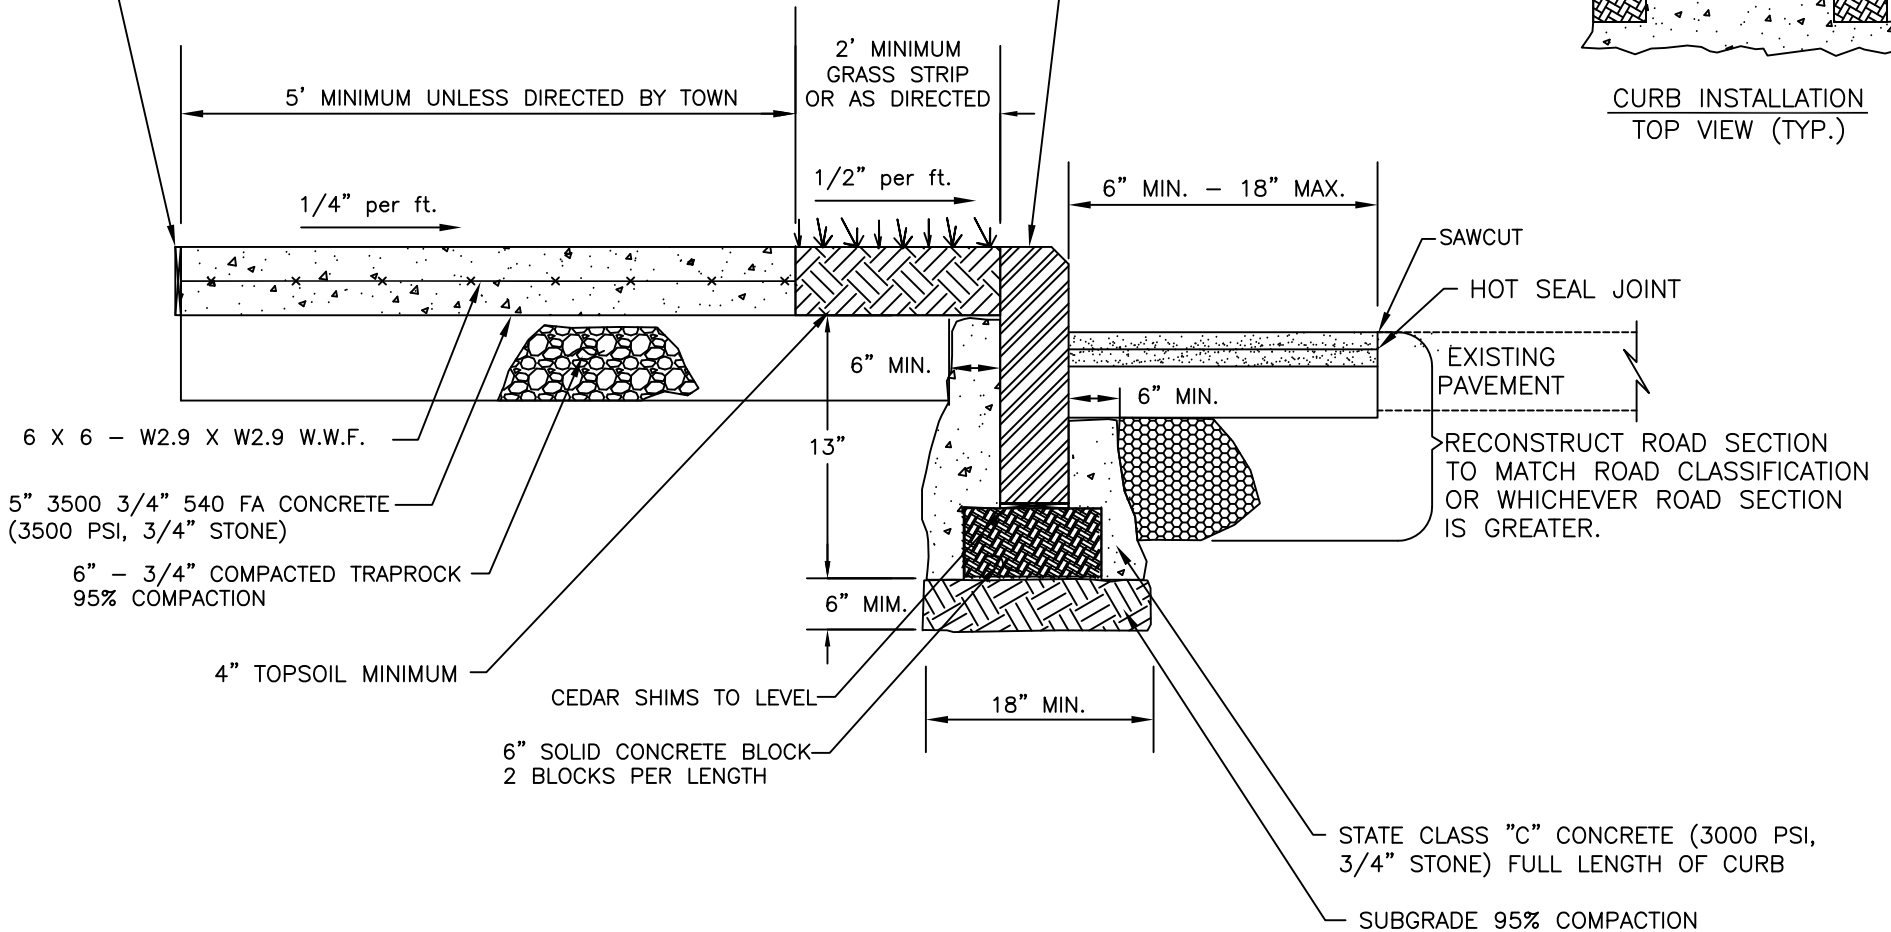

NOTES:

1. GRANITE CURB SHALL HAVE 1/4" BUZZED EDGE.
2. 6" CURB REVEAL REQUIRED UNLESS OTHERWISE DIRECTED
3. MINIMUM LENGTH OF STRAIGHT CURB SHALL BE 3'-0" AND RADIUS CURB SHALL BE 2'-6"
4. JOINTS IN GRANITE CURB SHALL BE GROUTED. LEAVE OPEN JOINT APPROXIMATELY EVERY 30' O.C. TO ALLOW FOR EXPANSION.
5. IF ORDERED TO PIN SIDEWALK TO BUILDING, SEE SCD No. 921.13

SCALE = N.T.S.

STANDARD CONSTRUCTION DETAIL
CONCRETE SIDEWALK WITH GRASS STRIP AND GRANITE CURB
TOWN OF GREENWICH, CONNECTICUT ENGINEERING DIVISION DEPARTMENT OF PUBLIC WORKS